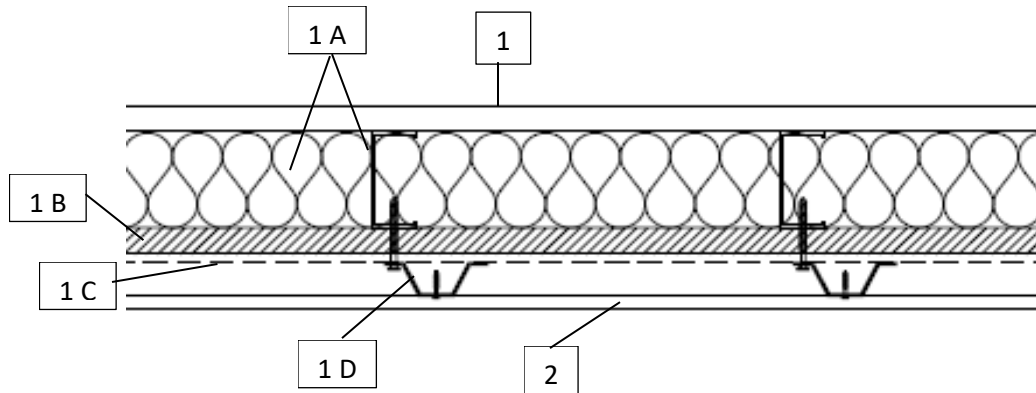

ChamClad
Design No. CWL/SI 30-01
ChamClad PVC Siding
NFPA 285
Rating: Meets Conditions of Acceptance



1. WALL ASSEMBLY: Construct a wall assembly that shall comply with the local Building Code or other applicable regulatory requirements as established by the local Authority Having Jurisdiction. Where used, the wall assembly shall include:

- A. **FRAMING** – Use min. 20 GA steel or wood studs spaced max. 406 mm (16 in.) on center (oc), with R-11 batt fiberglass insulation in stud cavities. Wood studs must conform to the Building Code design requirements.
- B. **EXTERIOR SHEATHING** – Install one layer of min. 15.9 mm (5/8 in.) ASTM C1177 gypsum exterior sheathing to framing.
- C. **AIR AND MOISTURE BARRIER** – Install DuPont™ Tyvek® Commercial Wrap®.

- D. **FURRING** – Install 20 GA, min. 38 mm (1-1/2 in.) width and min. 19 mm (3/4 in.) depth, galvanized steel hat channel vertically spaced not more than 406 mm (16 in.) oc. Fasten one side of the hat channel through exterior sheathing to metal studs using 32 mm (1-1/4 in.) self-tapping galvanized or stainless-steel screws spaced at max. 12 in.

2. COMPONENT NAME: Siding

CERTIFIED PRODUCT: ChamClad, ChamClad® Siding

Rigid PVC extruded tongue and groove PVC panels with hollow core profile and factory laminated PVC film.

ChamClad® 6 in. Exterior Wall Panel – Nominal dimensions are 150 mm wide x 13 mm thick x 1.65 mm wall thickness.



ChamClad® 12 in. Wall Panel – Nominal dimensions are 300 mm wide x 10 mm thick x 0.94 mm wall thickness.

ChamClad Accessories and Trims including PVC and aluminum starter strips, finishing trim, outside and inside corner trim, H mold, and J trim.

Install siding panels horizontally through nailing slots along the top edge of profiles to furring using 19 mm (3/4 in.) #8 pan-head, self-tapping metal screws.

- 3. VERTICAL JOINTS:** Where vertical joints are present between horizontally installed ChamClad panels, use a PVC ChamClad H trim to cover the joint.

Consult the listing report on the Directory of Building Products (<https://bpdirectory.intertek.com>) for the edition of the standard(s) evaluated.

Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.